


Flow chart - RAL-RG 426

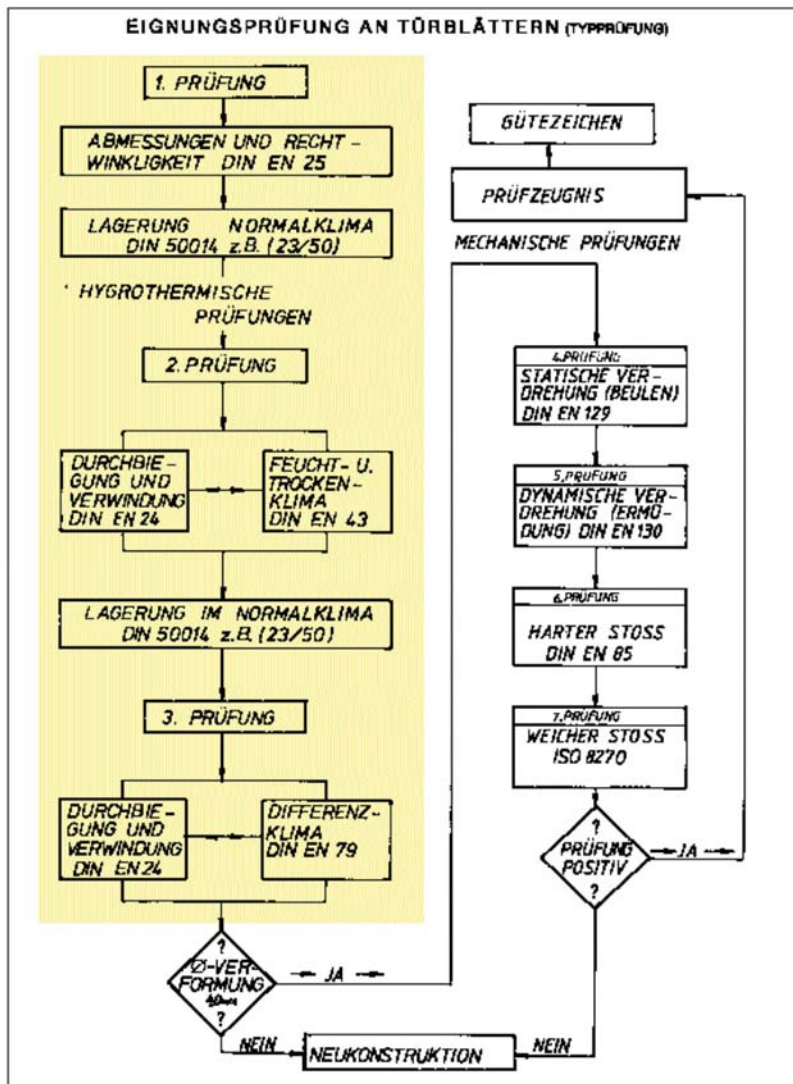

Climates

Pre-climate:

Both sides are being impinged in the same way.

- normal climate: 23°C / 50% relative humidity of air
- damp climate: 23°C / 85% relative humidity of air
- dry climate: 23°C / 30% relative humidity of air
- normal climate: 23°C / 50% relative humidity of air

Duration: 7 days/climate = 28 days

Differential climate:

Inside and outside are being impinged in a different way.

Inside:
dry climate: 23°C / 30% relative humidity of air

Outside:
Climate Class 1: 18°C / 50% relative humidity of air
Climate Class 2: 13°C / 65% relative humidity of air
Climate Class 3: 3°C / 85% relative humidity of air

Duration: 28 days

Official testing institutes:

PTE Rosenheim GmbH
83026 Rosenheim
Tel.: 08031 / 261 251 00
Fax: 08031 / 261 259 00

Wilhelm-Klauditz-Institut
38108 Braunschweig
Tel.: 0531 / 21 55 - 375
Fax: 0531 / 35 15 87

Institut für Technische Akustik
10587 Berlin
Tel.: 0 30 314 -22 428
Fax: 0 30 314 -25 135

Institut für Holztechnologie Dresden
01217 Dresden
Tel.: 0351 / 46 62 - 281
Fax: 0351 / 46 62 - 211